





Report Code: 2025/Mat./1179

Subject:	Testing of composite fiberglass reinforcement of AKC grade of Ø10 mm, Ø12 mm, and Ø16 mm compliance with ASTM D7205-21 requirements
Client:	TERRA TECH Environmental Solutions L.C.C. company


Prepared by	Signature
Eng. Mahmoud Mamdouh Zakaria	
Reviewed by	Signature
Dr. Eng. Omaila Mostafa Hamed	
Approved by	Signature
Eng. Karem Farouk Ibrahim	





إدارة التخطيط والبحوث والدراسات
مركز الأبحاث

اختبارات معملية على عينات GFRP

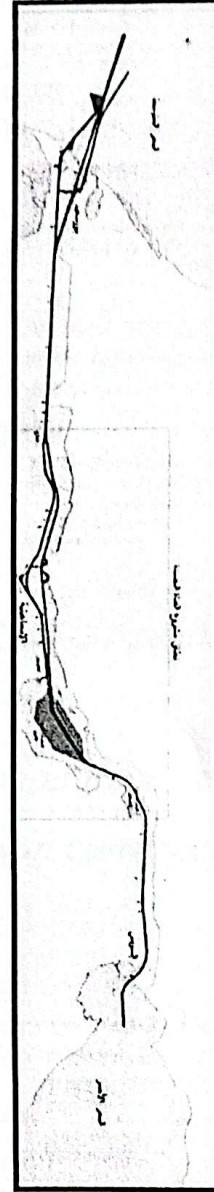

نوفمبر ٢٠٢٥

(2025/Mat./1179)

Suez Canal Authority
Planning, Research, and Studies Department
Research Center

Egypt, Ismailia
P.O. box 41515 Ismailia

(+2064) 3396847 fax (+2064)3396848

Research.Center@suezcanal.gov.eg
www.suezcanal.gov.eg

Code No. 2025/Mat/1179
Dated Nov.16, 2025

APPROVED BY
Head of Research Center
Ahmed Hassan Amin

Signature.

TEST REPORT
Glass Fiber Reinforced Polymers


*Testing of composite fiberglass reinforcement of AKC grade of Ø10 mm.
Ø12 mm, and Ø16 mm compliance with ASTM D7205-21 requirements*

(According to ECP 208-2019)

*Egyptian code for Design Principles and construction Requirements
For the use of Fiber Glass-Reinforced Polymers in construction*


Prepared by: Eng. Mahmoud Mamdouh Zakaria

Signature.



Reviewed by: Dr. Eng. Omaila Mostafa Hamed

Signature.



Approved by: Eng. Karem Farouk Ibrahim

Signature.



Ismailia Governorate

2025

LIST OF EXECUTORS

The Manufacturer: TERRA TECH Environmental Solutions

L.C.C. company

Test Supervisor


Deputy Manager:
Eng. Karem Farouk Ibrahim

Signature.



Head of Soil Research Division:
Omaira Mostafa Hamed

Signature.



Test Executors:

Assistant Manager of Works:
Mahmoud Mamdouh Zakaria

Signature.






TABLE OF CONTENTS


INTRODUCTION.....	1
TEST RESULTS.....	2
I. DETERMINATION OF NOMINAL DIAMETER.....	2
II. TESTS FOR AXIAL TENSION.....	3



INTRODUCTION

- The tests have been performed upon an order of TERRA TECH.
- Tested object: Fiberglass reinforcement of AKC grade of 10 mm, 12 mm and 16 mm diameter.
- Sample tagging – fiberglass reinforcement of AKC grade 10 mm, 12 mm and 16 mm.
- Address of the manufacturer of the tested objects: Investment Zone in Mit Ghamr
- Name of the manufacturer of the tested objects: TERRA TECH, LLC.
- Sampling reports (number, date): No. 2025/Mat./1179 dated Nov. 16, 2025.
- Test purpose: Determination of physical and mechanical characteristics of fiberglass reinforcement for compliance with the requirements of ECP 208-2019 “Composite polymer reinforcement for armoring concrete structures. General specifications”.
- Physical and mechanical characteristics to be determined:
 - Nominal diameter and cross-section area
 - Strength limits at axial tension
 - Elasticity modulus
- Reference documents for testing methods:
 - ECP 208-2019 “Composite polymer reinforcement for armoring concrete structures. Methods of determining physical and mechanical characteristics”
 - ECP 208-2019 “Composite polymer reinforcement for armoring concrete structures. General specifications”.









TEST RESULTS

1. DETERMINATION OF NOMINAL DIAMETER

- Sample tagging – fiberglass reinforcement of AKC 10 mm, 12 mm and 16 mm grade;
- Name of organization conducting the tests – Suez Canal Authority Research center;
- Test date – 27.10.2025;

Nominal diameter and cross-section areas of deformed composite fiberglass reinforcement of 10 mm, 12 mm and 16 mm diameter is given in table 1.

Table 1 – Nominal Diameter and Cross-section Area

Sample No.	Sample length, mm	Nominal diameter, mm	Cross section area, mm ²	Average
1	204.1	10.04	79.20	78.99
2	204.3	10.03	79.04	
3	205.1	10.01	78.73	
4	200.2	12.02	113.52	113.52
5	205.2	12.01	113.33	
6	204.8	12.03	113.71	
7	215.1	16.01	201.39	177.10
8	205.6	16.01	201.39	
9	204.2	16.02	201.65	

Yahmoud

Omama M




[Handwritten signature]

II. TESTS FOR AXIAL TENSION


- Test date - 27.10.2025.
- Results of tests for axial tension of composite fiberglass reinforcement are given in table 2 and figures 1-2.

Table 2 – Strength Limit for Axial Tension of Composite Fiberglass Reinforcement

Sample No.	Nominal diameter, mm	Cross- section area, mm ²	Max. load, kg f	Strength limit, MPa		Elasticity modulus, MPa		Relative extension, %	
				Single	Average	Single	Average	Single	Average
1	10.04	79.20	10996.9	1388.497	1359.941	15648	14314	14.06	13.07
2	10.03	79.04	10681.9	1351.455		13620		12.33	
3	10.01	78.73	10548.8	1339.87		13673		12.82	
4	12.02	113.52	15772.5	1389.403	1356.98	12512	9792	25.15	27.38
5	12.01	113.33	14690.6	1296.268		8794		29.13	
6	12.03	113.71	15751.9	1385.27		11070		27.86	
7	16.01	201.39	22425.0	1113.51	1156.64	6421	7071	23.08	22.33
8	16.01	201.39	24185.6	1200.93		8811		23.00	
9	16.02	201.65	23300.6	1155.50		5980		20.90	

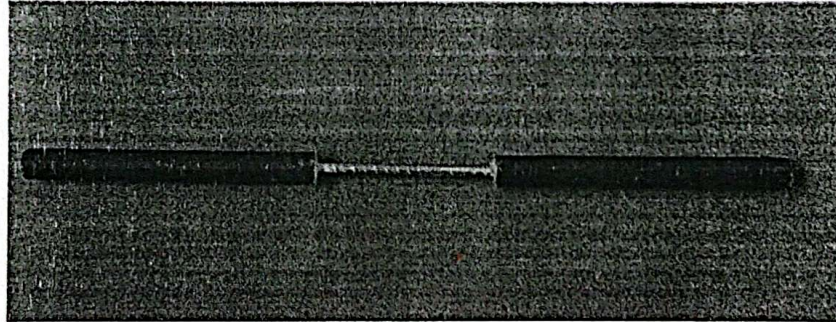


Sample No. 1 (10 mm)

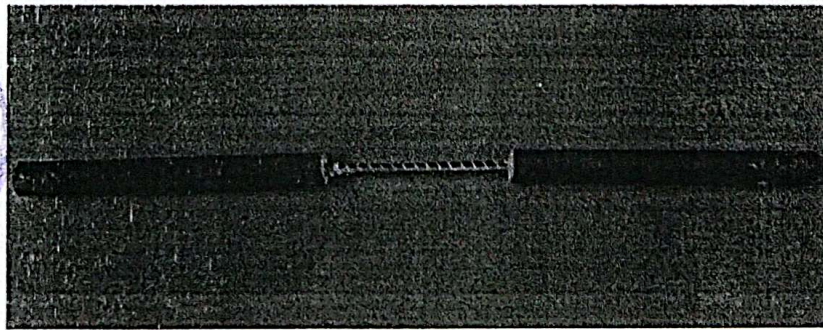


Sample No. 2 (10 mm)


Figure 1 – Composite Fiberglass Reinforcement after Tests for Axial Tension

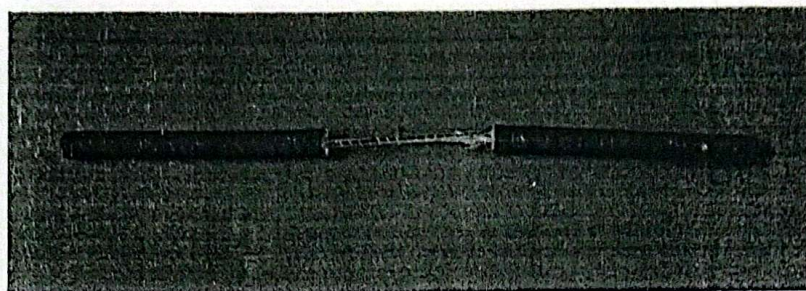


Sample No. 3 (10 mm)

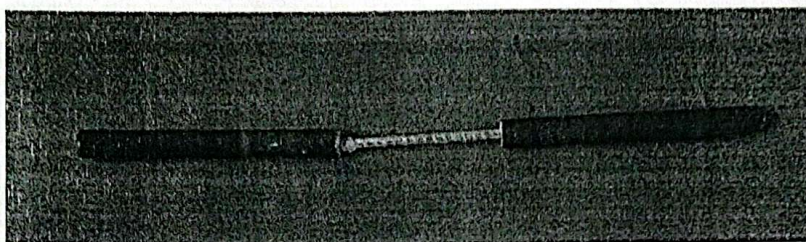

Sample No. 4 (12 mm)

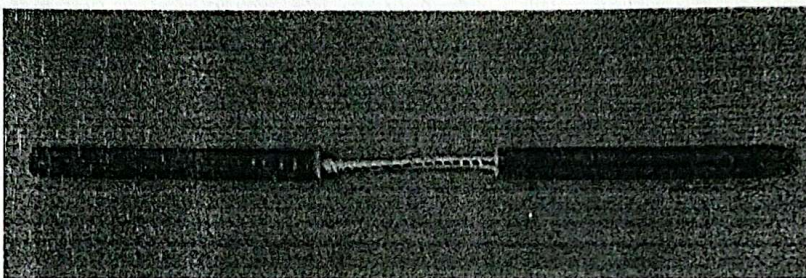

Sample No. 5 (12 mm)

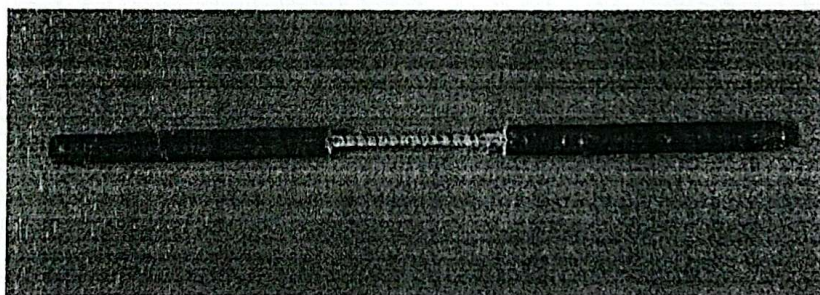

Sample No. 6 (12 mm)



Sample No. 7 (16 mm)

Figure 1 – Composite Fiberglass Reinforcement after Tests for Axial Tension (Cont.)

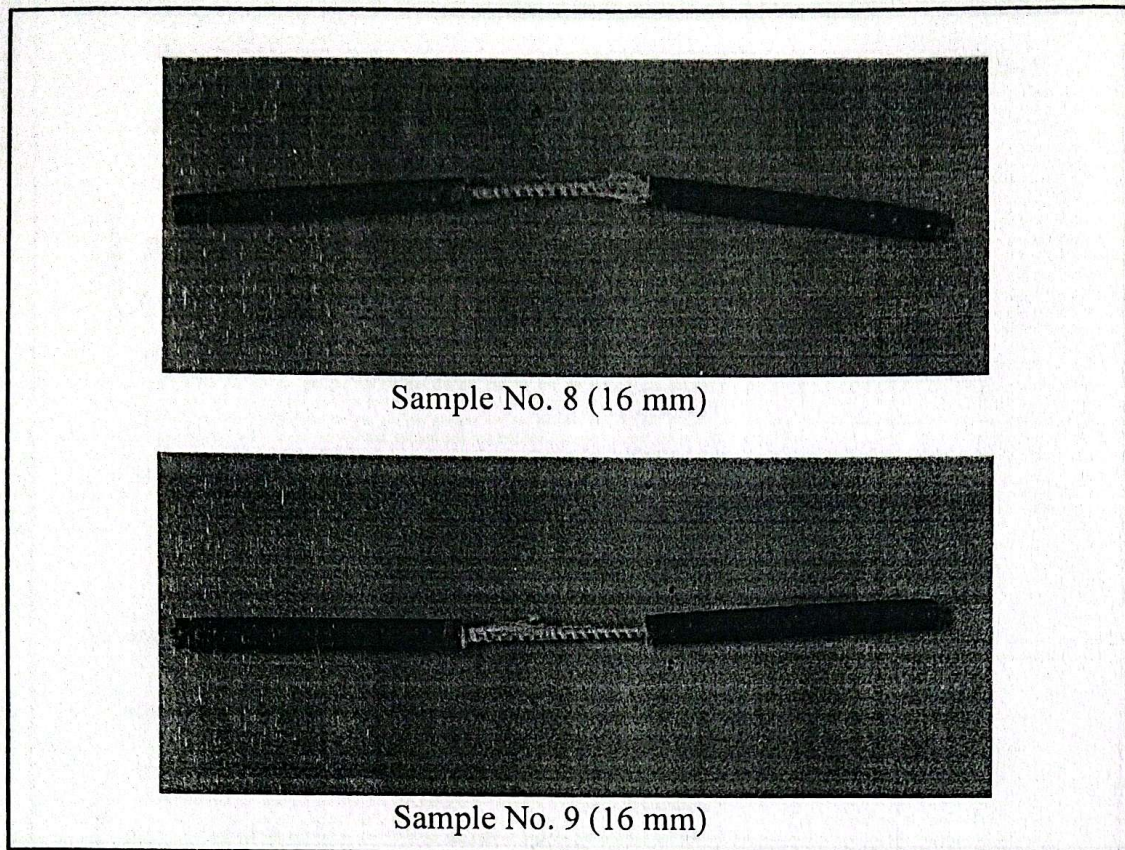


Figure 1 – Composite Fiberglass Reinforcement after Tests for Axial Tension (Cont.)

Ahmad

Dr. Ahmad



[Signature]

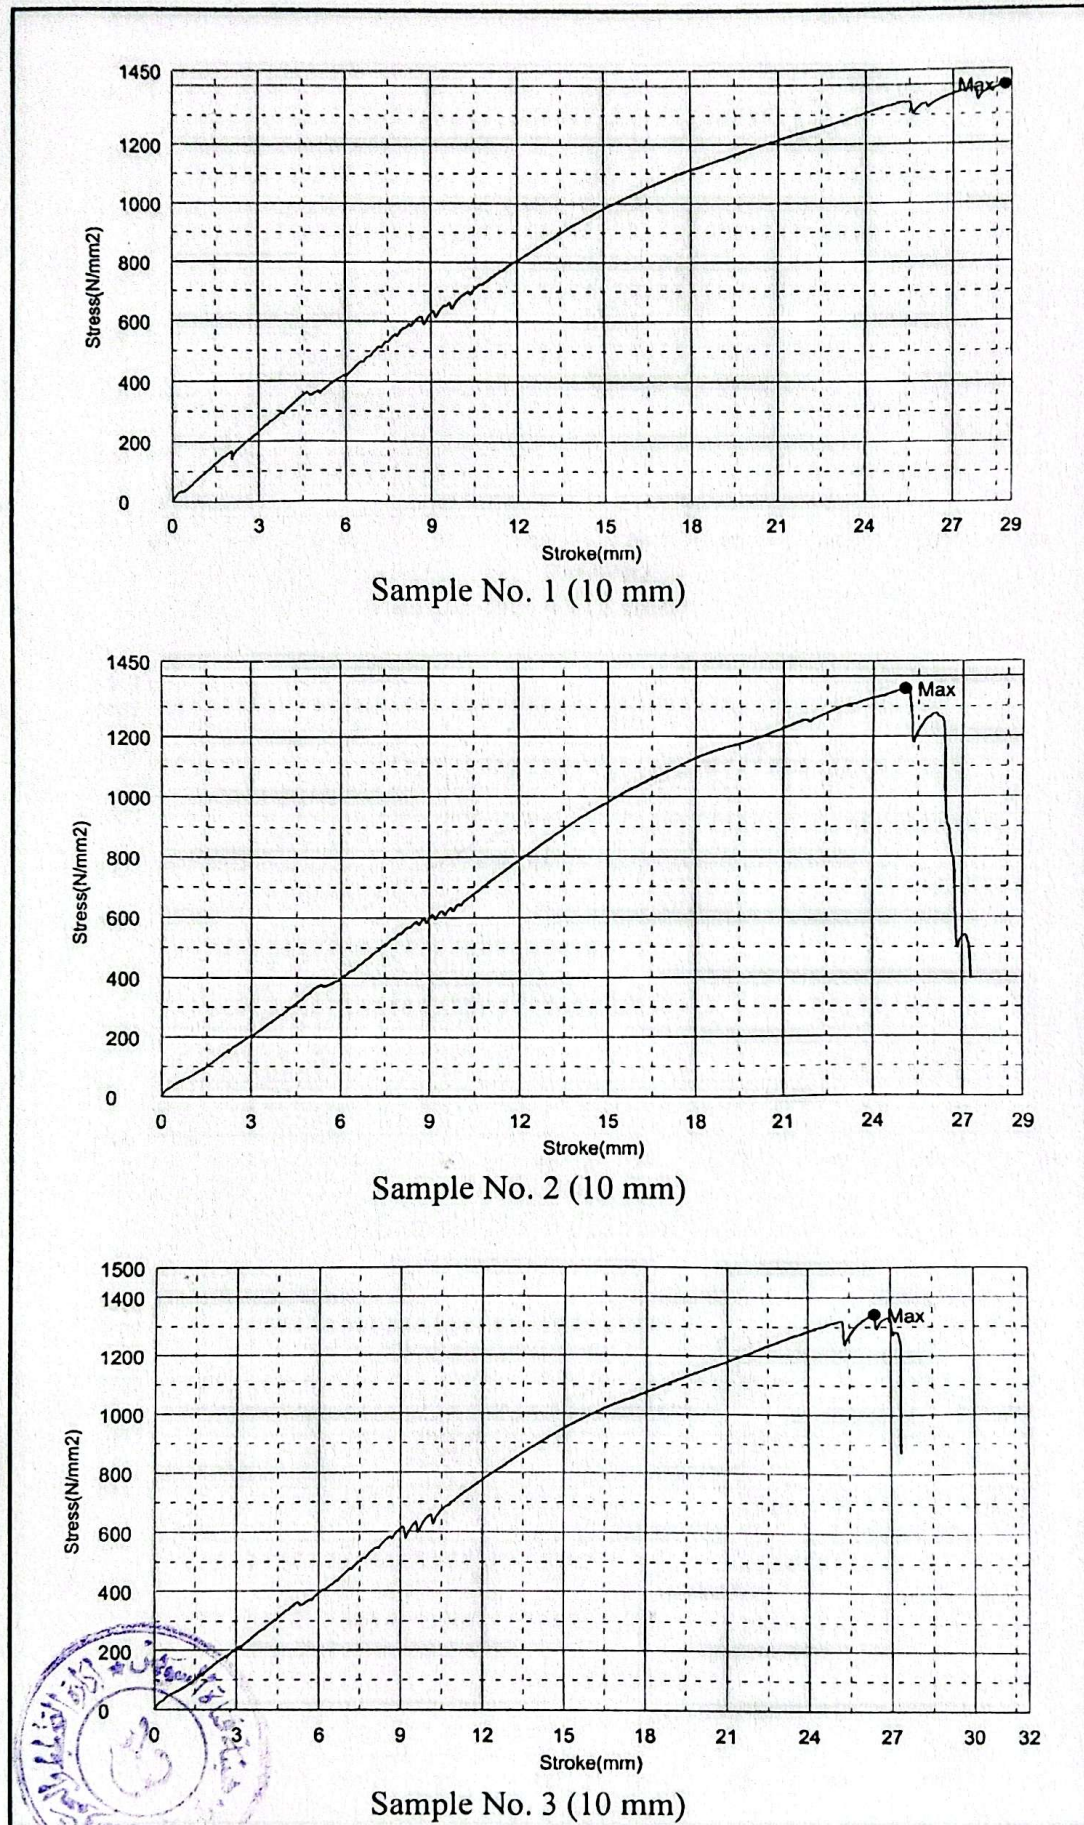


Figure 2 – Course of Testing of Composite Fiberglass Reinforcement for Axial Tension

ahmoud

Imam

[Signature]



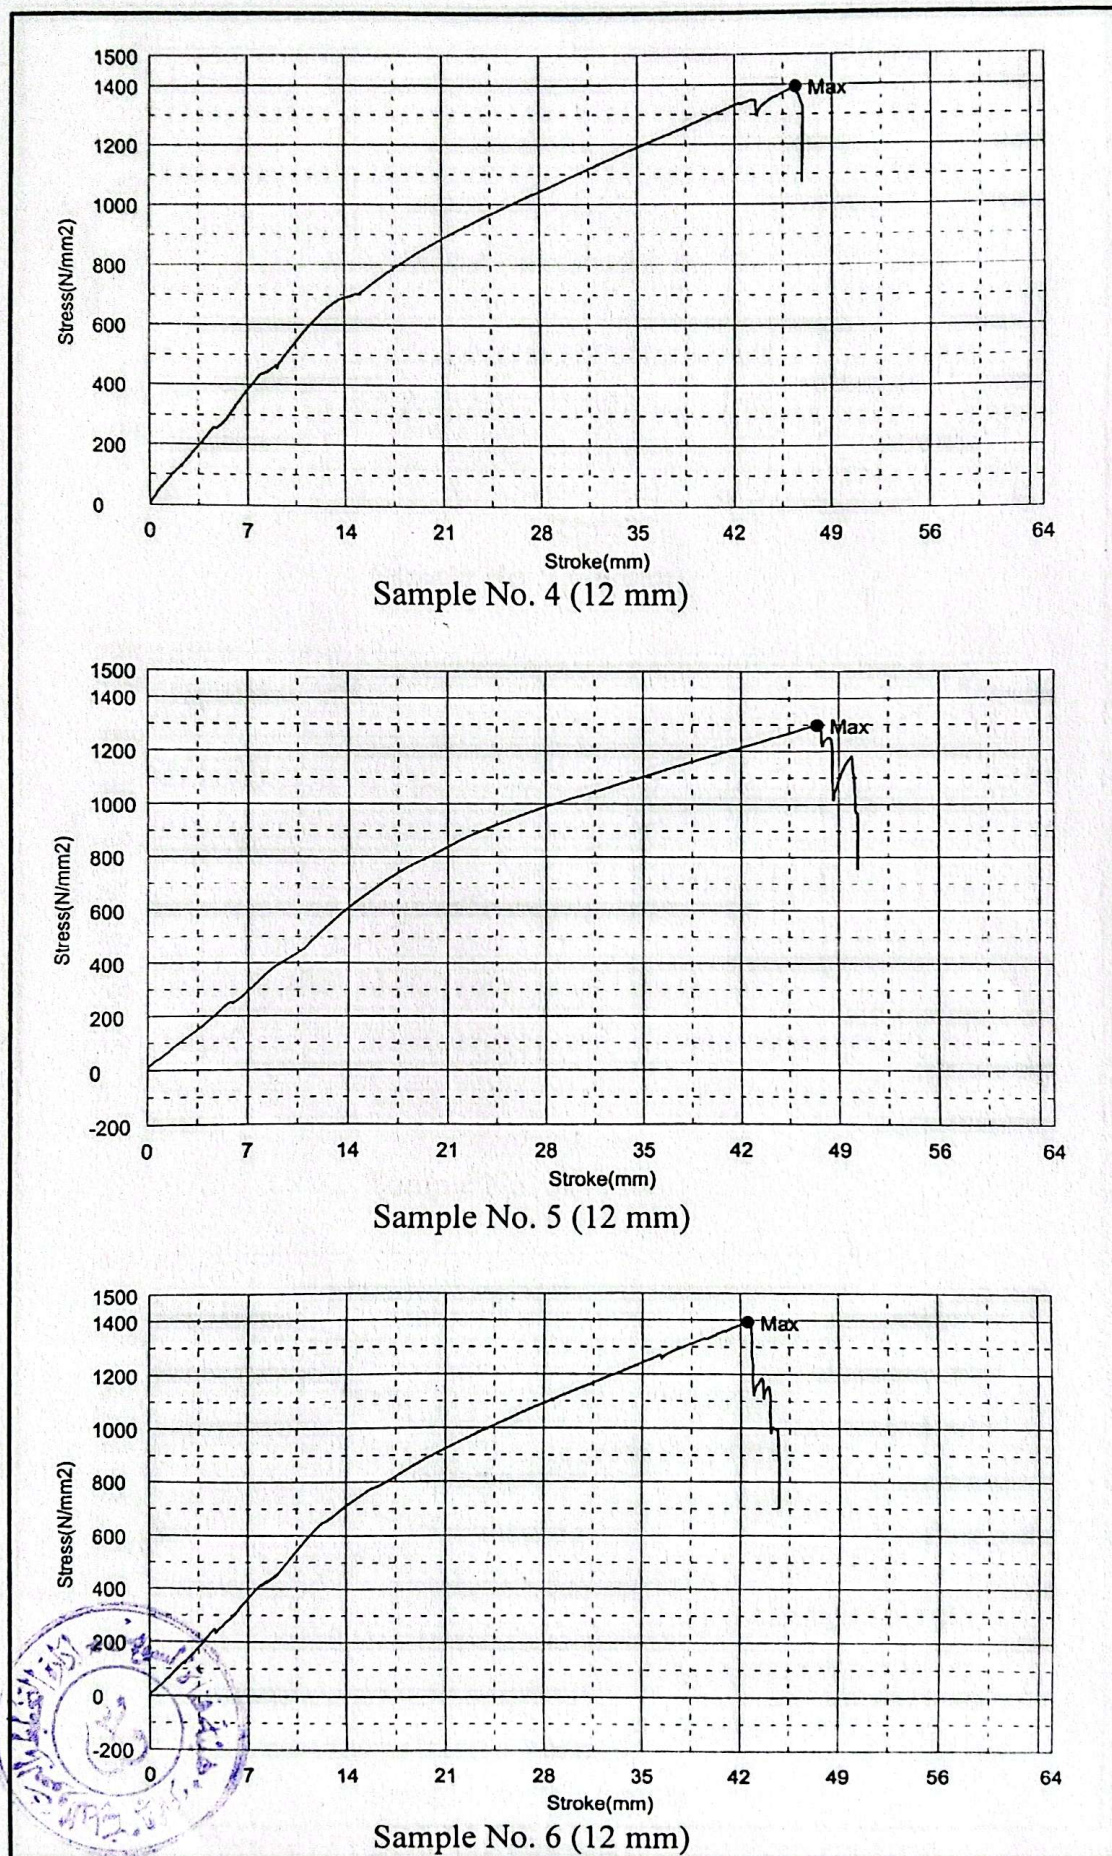



Figure 2 – Course of Testing of Composite Fiberglass Reinforcement for Axial Tension (Cont.)

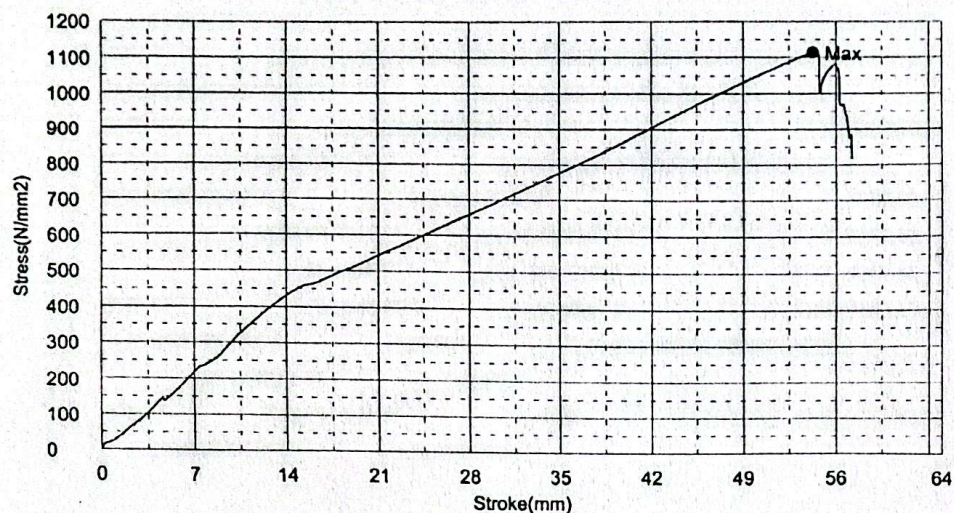

Sample No. 7 (16 mm)

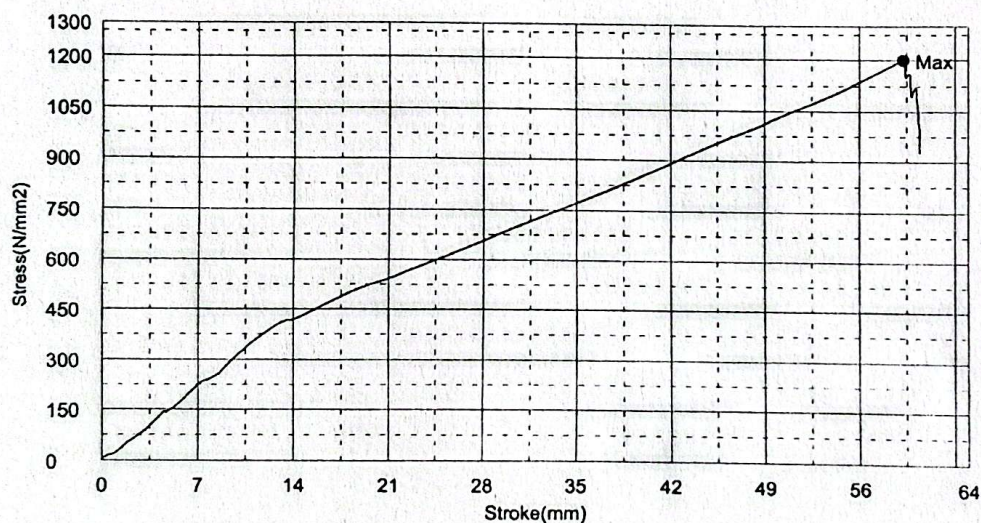

Sample No. 8 (16 mm)

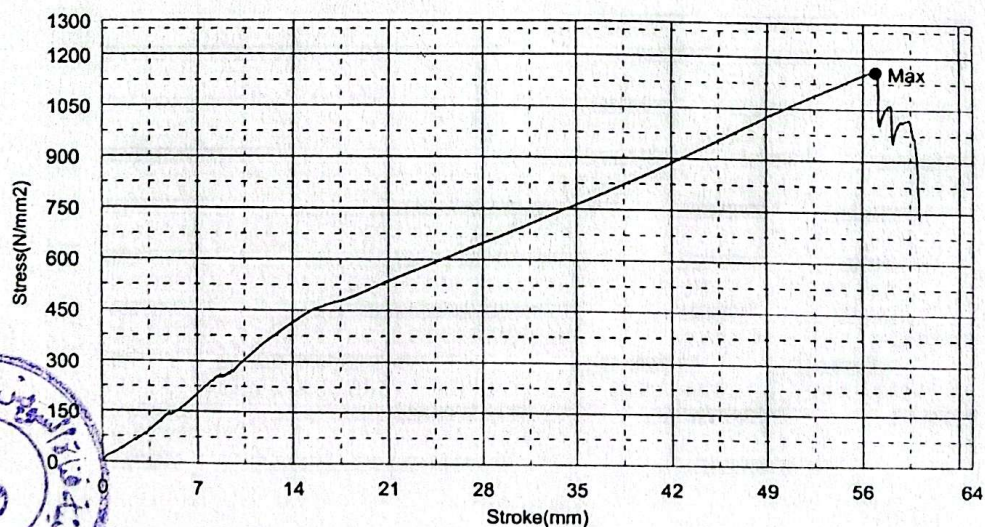

Sample No. 9 (16 mm)

Figure 2 – Course of Testing of Composite Fiberglass Reinforcement for Axial Tension (Cont.)

Signature

Signature

Signature